

Worcester Public Schools

Ventilation Assessment & COVID-19 Mitigation Strategies

for

Columbus Park Preparatory School Worcester, MA



January 31, 2021

Prepared by:

**Nault Architects Inc
71 Hope Ave
Worcester, MA 10603**

**Seaman Engineering Corporation
22 West St, Unit C
Milbury, MA 01527**

&

Worcester Public Schools

A. Preface:

Worcester Public School has as Nault Architects Inc. and their consultant Seaman Engineering Corporation (SEC) to review all of their occupied buildings and comment on existing natural and mechanical ventilation.

The first part of the report is SEC's evaluation of the existing mechanical systems.

The second part of the report is an evaluation of the natural ventilation. The Building Code requires ventilation of each occupied space and that can be achieved either through mechanical or natural ventilation methods. If the natural ventilation path is chosen, there must be a clear opening(s) in the space that meet or exceed the 4% of the total room square footage. After the field survey of each room / window type was complete, the ventilation information was added to a spread sheet for calculation of the 4% and color-coding. The calculations were also color-coded on a floor plans of the building for a better overall understanding of the existing conditions.

The natural ventilation color-coding (on the spreadsheet and plans) is as follows:

- **Green Spaces**: meets or exceed the code minimum natural ventilation.
- **Yellow Spaces**: does **not** meet the code minimum natural ventilation, but does have operable window to allow some natural ventilation.
- **Red Spaces**: does not meet the code minimum natural ventilation and does not have any operable windows.

It should be reiterated that the second part of this report is only measuring natural ventilation. Therefore, newer buildings or buildings with large amounts of fixed windows may have large amounts of red and/or yellow spaces, but that doesn't mean they are not code compliant, they may be relying on mechanical ventilation. However, for this part of the report, were asked to show a baseline for all schools without mechanical equipment.

B. Building Description:

Columbus Park Preparatory School:

Columbus Park Preparatory School is located in the South Quadrant of Worcester at 75 Lowell Street. The School was built in 1913, houses grades K-06, has 19 classrooms and the building is 59,837 square feet. The building windows were replaced in 2015.

C. Table of Contents:

1) Mechanical Ventilation Report	16
2) Natural Ventilation Summary.....	5

1) Mechanical Ventilation Report

TABLE OF CONTENTS

I. EXECUTIVE SUMMARY..... 2

II. HVAC VENTILATION ASSESSMENT..... 5

 A. General..... 5

 B. Evaluation..... 7

 C. IAQ & Ventilation Summary..... 9

III. COVID-19 HVAC MITIGATION MEASURES..... 13

 A. HVAC COVID-19 Control Measures..... 13

 B. Enhanced HVAC COVID-19 Control Measures 15

I. EXECUTIVE SUMMARY

This report briefly describes the existing ventilation systems at the Columbus Park Preparatory Academy in Worcester, MA as well as their capabilities to support current code required ventilation rates. In addition, we have evaluated the systems ability to support recommendations in accordance with the American Society of Heating Refrigeration and Air Conditioning Engineers (ASHRAE) Epidemic Task Force Building Readiness Guidelines (updated 10-20-2020). Several of the ASHRAE recommendations as well as those from the Harvard T.H. Chan School of Public Health and other industry sources have been presented for consideration to assist in further mitigating virus transmission through the buildings heating, ventilation, and air conditioning (HVAC) systems.

Our inspection of the existing systems was limited to visual observations coupled with review of original design drawings, when available. The findings presented in this report presume the systems are operational and delivering air quantities indicated on the original design drawings. Proper operational testing of each piece of equipment and airflow measuring would be required to confirm such operation.

During, our visual inspection we also took several spot measurements of air quality in various locations throughout the school. Measurements taken were limited to Temperature (°F), Relative Humidity (% RH), CO₂ (carbon dioxide in ppm), CH₂O (formaldehyde in ppm) and Total Volatile Organic Compounds (TVOC in ppm).

The results of the readings taken during our inspection were only used to identify areas where possible ventilation issues may exist and/or to identify areas where a source contaminant may be causing elevated levels.

COVID-19 Control Measures:

In line with the current American Society of Heating Refrigeration and Air Conditioning Engineers (ASHRAE) Epidemic Task Force Building Readiness Guidelines (updated 10-20-2020) and those from the Harvard T.H. Chan School of Public Health - 5-Step Guide to Checking Ventilation Rates in Classrooms, as well as other industry recommendations the following HVAC COVID Control Measures (CCM's) are presented for consideration to assist in mitigating virus transmission thru the HVAC systems. The following descriptions are abbreviated with additional detail found later within the report.

As of the writing of this report, the City of Worcester Public Schools (WPS) has already begun implementation of several of the measures noted below where possible. For enhanced measures WPS has begun to incorporate Bipolar Ionization (see ECCM-#3) extensively throughout the Columbus Park Preparatory Academy to address the current pandemic condition.

CCM #1 – Pre & Post Purge Ventilation – Pre- and post-purge ventilation of occupiable spaces using outside air introduced thru the HVAC systems for an extended period of time prior to and after occupancy.

The building has a mix of HVAC system types many of which appear to be capable of implementing this measure presuming the systems are in operational order.

CCM #2 – Increased Ventilation - Increase the quantity of outdoor air ventilation for improved space dilution where systems allow. Disable demand ventilation reset. The Harvard T.H. Chan School of Public Health identifies 3 outdoor air changes per hour (ACH) as the “bare minimum” during a pandemic condition.

The building has a mix of HVAC system types many of which appear to be capable of implementing this measure presuming the systems are in operational order.

CCM #3 – Improved Filtration - Improve filtration to up to MERV-13 or higher on recirculating air handling systems which can support such filtration.

The unit ventilators in the school will not support increased filtration above MERV 8 either due to physical equipment limitations (i.e., unit ventilators limited to 1” filters) or due to fan capacity limitations. The air handling systems serving the gym and several other areas (undefined) are old and may not be capable of supporting increased filter efficiency. In addition, at least the gym system is shown as a 100% OA system which would not benefit as greatly from increased filtration as no space recirculation occurs. Increased filtration efficiency can lead to faster filter loading and a potential reduction in ventilation air for systems not designed to support this filtration level.

In addition to the above suggested measures, we have also presented Enhanced HVAC COVID-19 Control Measures (ECCM) which could be considered for implementation. Where the above CCM’s cannot be employed, one or more of the ECCM measures outlined herein may be utilized to improve indoor air quality. The following descriptions are abbreviated with additional detail found later within the report:

ECCM #1: Portable Room Purifiers - Portable room air purifiers may be used in select areas to help clean the air within that space. These can be especially helpful where rooms have low outdoor air changes per hour and cannot be supplied with additional outdoor air or where existing systems cannot accommodate improved filtration.

ECCM #2: UV-C Light Sterilization - UV-C lights may be considered for insertion in equipment and ductwork to help neutralize viruses as it is exposed to the light.

ECCM #3: Bipolar Ionization - Air ionizers may be installed in air handling systems or portable units installed in rooms to improve indoor air quality. These systems cause particles and airborne contaminants to bind together thereby increasing their size, so they tend to either drop out of the breathing zone or be better removed by air filtration. Recent studies have also shown Bipolar Ionization may inhibit the COVID-19 virus’s ability to infect.

WPS has begun to incorporate Bipolar Ionization extensively throughout the Columbus Park Preparatory Academy to address the current pandemic condition.

Recommendations Summary:

Based on our site inspections, sample air quality readings and review of original drawings we found that a majority of the occupied areas of the Columbus Park Preparatory Academy appear to have systems with the potential to comply with current ventilation codes, pending balancing and verification, with few exceptions noted herein. However, in order to address the pandemic level conditions currently in place the following table summarizes our recommendations, several of which, align with the American Society of Heating Refrigeration and Air Conditioning Engineers (ASHRAE) Epidemic Task Force Building Readiness Guidelines (updated 10-20-2020) as well as those from the Harvard T.H. Chan School of Public Health.

WPS has already begun to incorporate Bipolar Ionization (ECCM-#3) extensively throughout the Columbus Park Preparatory Academy to address the current pandemic condition.

Space	Exist. O.A. Vent. Systems	Recommendations
Gymnasium	AHU-1	CCM-#1 & #2 ECCM - #3
General Classrooms	Unit Ventilators	CCM - #1 & #2 ECCM - #3
Library & Some Classrooms	AHU-2	CCM - #1 & #2 ECCM - #1 or #3 (*see note below) Ensure AHU-2 is operational as EMS does not describe operation.

**Note: For individual classrooms and other areas noted, ECCM #1 – Portable Air Filtration and/or ECCM #3 – Ionization, are noted as possible options to improve air cleaning and changeover during pandemic conditions.*

Inevitably, during a pandemic, the best approach is a multi-faceted one which should include the above HVAC strategies as well as proper housekeeping (cleaning of spaces and surfaces), occupant actions (hand cleaning, wearing masks, social distancing, following recommended CDC guidelines) and other mitigation strategies.

II. HVAC VENTILATION ASSESSMENT

A. GENERAL

Over the last several weeks we performed site inspections of the existing school building to assess the ventilation systems in place. Manufacturer and model information was obtained from the existing ventilation equipment, when available/accessible, and visual conditions were noted.

For our review, original design drawings as well as drawings of various modifications over the years for the school were received from school facilities. In addition, we have also received and reviewed the available HVAC control drawings to ascertain current control configuration. We have used these documents to ascertain the original design ventilation rates so as to compare them to current ventilation codes and standards.

Our inspection was limited to visual assessment of systems and did not include operational testing of each piece of equipment or airflow measuring. We have however, taken some spot measurements of air quality in various locations throughout the school. Measurements taken were limited to:

- Temperature (°F)
- Relative Humidity (% RH)
- CO₂ (carbon dioxide in ppm)
- CH₂O (formaldehyde in ppm)
- Total Volatile Organic Compounds (TVOC in ppm)

These readings were taken at a specific moment in time and may vary during the day based on space occupancy, use and activities as well as the operational state of the HVAC systems. For example, most all spaces surveyed were unoccupied or very lightly occupied and as such most all CO₂ levels were low since space CO₂ is primarily generated by occupants.

TVOC's sources can vary widely and include but are not limited to paints, finishes, adhesives, cigarette smoke, pesticides, personal care products, car exhaust, new furnishings, wall coverings, cleansers, and cooking fuels. The meter used included the following chemicals in its TVOC analysis: Acetone, Ethylene Glycol, Formaldehyde, Xylene, 1,3-Butadiene, Tetrachloroethene, Hydrogen Sulfide, Ammonia, Toluene, Benzene, Methylene Chloride, Perchloroethylene, and MTBE. The meter cannot read every possible VOC nor quantify percentages of various VOC's. In addition, we did notice the TVOC readings tended to drift up during the study, possibly due to a calibration issue, as such, the readings in this report were only used to identify areas where possible ventilation issues may exist and/or to identify areas where a source contaminant may be causing elevated levels.

The report ventilation calculations presume, the existing systems are operating to the levels reflected on the original design drawings. Testing and Balancing by a certified balancer would be required to confirm actual airflows.

For ventilation calculations, data from current codes including the International Mechanical Code (IMC) 2015 and ASHRAE 62.1-Ventilation for Acceptable Indoor Air Quality were used. The outdoor airflow values have been corrected to adjust for the distribution systems ability to get the outdoor air to the space breathing zone with the breathing zone being within 6 feet of the occupied floor. This correction factor also known as the Zone Air Distribution Effectiveness (ZDE), varies based on how and where the air is introduced and removed from the room as well as the temperature of the air entering the room. Some examples of ZDE for various systems are as follows:

<u>Distribution Configuration</u>	<u>ZDE</u>
Ceiling supply of cool air (air below room temp.)	1.0
Ceiling supply of warm air & floor return	1.0
Clg. supply of warm Air >15F above space temp. & clg. return	0.8
Floor supply of warm air & floor return	1.0
Floor supply of warm air & ceiling return	0.7
Displacement cooling floor supply & ceiling return	1.2

For example, a displacement cooling system with a ZDE of 1.2 would require 17% ($1.0 / 1.2$) less outside air to properly ventilate a space than a system with warm air supplied at the ceiling level being that the displacement system is more effective in getting the outdoor air into the breathing zone. A room with a ZDE of 0.8 would require 25% ($1.0 / 0.8$) more outdoor air to comply with ventilation standards.

This report contains a brief description of the types of ventilation systems serving the building as well as makes recommendations, where applicable, to improve ventilation of area served by these systems. Our evaluation considered the recommendations made by the American Society of Heating Refrigeration and Air Conditioning Engineers (ASHRAE) Epidemic Task Force Building Readiness Guidelines (updated 10-20-2020) as well as those from the Harvard T.H. Chan School of Public Health and other industry sources. All to assist in further mitigating virus transmission through the buildings heating, ventilation, and air conditioning (HVAC) systems.

B. EVALUATION

The following evaluation is based on visual observation of systems and equipment and excludes any operational testing which we understand is on-going by WPS. Evaluation includes information obtained from Worcester Public Schools on current air filters as well as existing building mechanical plans when available. In some cases, equipment was not accessible, and assessment was based only on original design drawings where available.

General Classrooms & Misc. Areas:

A majority of the classrooms in the building are heated with a mix of classroom unit ventilators and radiators. Ventilation for some rooms appear to be tied to a ducted fan or gravity driven ventilation system. The operational condition of this system is unknown and is not clearly identified on control drawings. The rooms with UV's are fitted with air 1" thick filters with an estimated MERV rating of 7 or 8 which is typical for units of this type. These units can support a maximum filter efficiency of MERV 8.

The rooms with classroom unit ventilators are connected to louvers along exterior walls with each having an associated control damper to allow outdoor air to enter the classroom space through the unit ventilator. Existing control drawings reflect control of these UV systems. Although control drawings do not reflect a sequence of operation, typically, during occupied periods, the unit fans would be configured to run continuous to provide space ventilation and electric operators modulate the steam valve, face & bypass dampers (where applicable) and mixing dampers to maintain space temperature setpoint. During unoccupied periods, the fans cycle off and only cycle on with the associated steam valve opening when there is a need for heating or economizer (OA) cooling. Control operation should be verified to insure continuous ventilation during occupied periods. Old drawings show 630 CFM of outdoor air being introduced through the unit ventilator system.

The operation of the ducted shaft ventilation system serving several classrooms is unknown and is not reflected on existing control drawings. Further review of this system would be required to ascertain its operational condition and capabilities.

For a standard classroom, current code would require 10 CFM per person of outside air plus 0.12 CFM per SF. For a system with a presumed zone air distribution effectiveness of 1.0, a room size of 800 SF with 26 occupants (25 students + 1 teacher) would require 356 CFM of outdoor air (445 CFM if ZDE = 0.8). As such, for the UV systems, more than the required code outside air is being supplied. Testing and Balancing of these and other systems, would be required to confirm outdoor airflow rates.

Bathroom and local exhaust requirements are supported by sidewall and roof mounted centrifugal exhaust fans of unknown capacity.

Gymnasium:

The gymnasium space is supported by a single 100% OA air handling unit. The volume of outdoor air the system moves is unknown however, per the control drawings it appears to vary the quantity of outside air based on OA temperature with less air being introduced as the OA temperature drops. The drawings also reflect an occupancy sensor which apparently enables and disables the system based on room occupancy.

The filtration level of the system is presumed to be MERV 8. As the system is reflected as a 100% OA system it would not benefit as greatly from increase filtration as no recirculation occurs. Increase filtration efficiency can lead to faster filter loading and a potential reduction in ventilation air for systems not designed to support this filtration level.

Science & Art Rooms:

There are no assigned science or art rooms indicated on the plans. Per the current code, science rooms and art rooms require higher ventilation levels than general use classrooms with a driving factor being required exhaust air. For science laboratories 1 CFM per SF of exhaust is required and for art rooms 0.7 CFM of exhaust is required along with the associated make-up air.

Office:

A portion of the office area appears to be supported by the old shaft ventilation system whose operational condition is unknown. Other office spaces appear to have no ventilation other than what could be afforded via operable windows.

Controls:

Controls in the building appear to be fairly comprehensive. As a minimum, from the control drawings it appears the building energy management system (EMS) controls the unit ventilators and the gym AHU unit. The EMS system is currently supported by Automated Building Systems, Inc (ABS). Further review with the EMS vendor would be required to ascertain the extent of this system.

The operating schedule for much of the equipment is based on the school's occupancy schedule. The schedule is adjustable via the front-end computer workstation.

C. IAQ & Ventilation Summary

IAQ Summary:

During our inspection we obtained spot measurements of air quality in various locations throughout the school. Measurements taken were limited to:

- Temperature (°F)
- Relative Humidity (% RH)
- CO₂ (carbon dioxide in ppm)
- CH₂O (formaldehyde in ppm)
- Total Volatile Organic Compounds (TVOC in ppm)

The readings were taken at a specific moment in time and may vary during the day based on space occupancy, use and activities as well as the operational state of the HVAC systems. For example, most all spaces surveyed were unoccupied or very lightly occupied and as such most all CO₂ levels were low since space CO₂ is primarily generated by occupants.

In addition, we noted some elevated TVOC levels and/or formaldehyde levels in areas which would not generally be expected to have such elevated levels. Although TVOC's (which includes formaldehyde) may come from varied sources such as cleaners, air fresheners and such, formaldehyde levels are often from off-gassing of furnishings or building materials. It is important to note that elevated levels of TVOC's may have been partially caused by recent enhanced cleaning measures or due to ventilation systems that were not in full operation at the time.

Measurements taken included space humidity. Humidity levels has been found to play a role in the controlling the spread of COVID-19. ASHRAE recommends winter humidity levels be kept between 40% to 50% and summer humidity levels between 50% and 60% with a summer target of 50%. Maintaining humidity levels within the above ranges has been found to limit the growth and transmission of certain bacteria and viruses as well as supports respiratory function. The below chart is taken from the 2020 ASHRAE Handbook – HVAC Systems and Equipment and reflects the impact of space humidity on the increase or decrease of effect on various space contaminants. This chart only reflects increase or decrease of effect from humidity and does not intend to imply that there is zero growth or impact of a certain contaminant when the sloped bar graph zero's out.

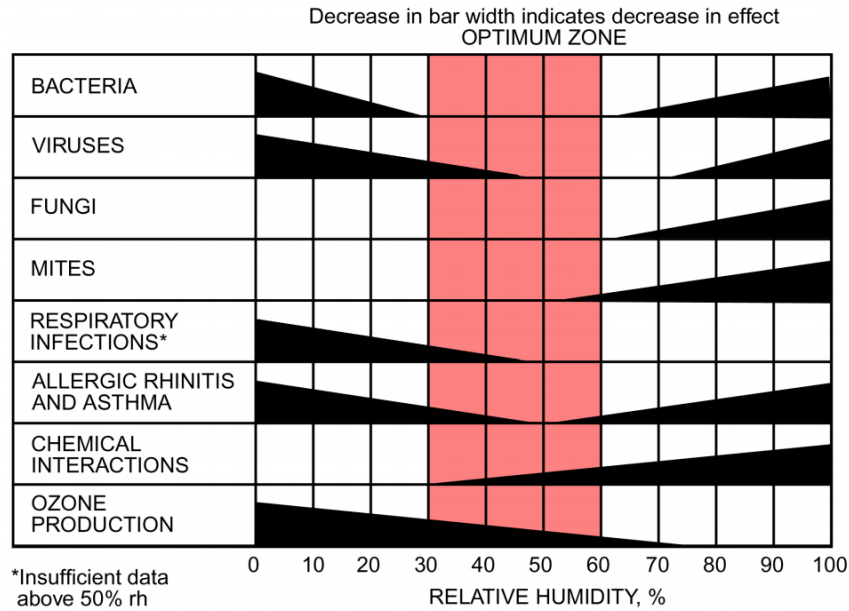


Fig. 1 Optimum Humidity Range for Human Comfort and Health
 (Adapted from Sterling et al. 1985)

The Columbus Park Preparatory Academy HVAC systems have no active humidity control. Space dehumidification is limited only to those areas which have air conditioning cooling. However, this dehumidification is not actively controlled by a humidity setpoint. Moisture removal only occurs when these systems are operating in the cooling mode. As such, space humidity may climb above 60% during periods when low thermal loads require less cooling (i.e., a cool damp day) or swing above and below 60% as the systems cycle based on space temperature.

Caution must be taken when considering adding active humidification to existing buildings as it is imperative that the buildings thermal envelope and vapor barriers be reviewed. Older structures, such as Columbus Park Preparatory Academy often have poor vapor barrier the varying wall and window construction and thermal characteristics may limit the ability for active humidification. Adding humidity in the wintertime without consideration of the building construction could result in moisture condensation on windows and within wall assemblies which may create a damaging and unhealthy condition for the building and its occupants. Review of the building envelope should take place prior to consideration of the addition of any humidification system. As such, our recommendations contained with this report exclude active humidification control until such time as the envelope can be reviewed.

The IAQ readings taken during the time of the inspection are contained within the table below. In addition, the table reflects the outdoor air exchange rate in the rooms based on design data from existing plans.

The document entitled “5-Step Guide to Checking Ventilation Rates in Classrooms” from the Harvard T.H. Chan School of Public Health recommends a target outdoor air exchange rate

during these pandemic conditions. The document identifies 5 air changes per hour (ACH) and above as “excellent” down to a 3 ACH being considered “bare minimum”. Many of the general classrooms in the Columbus Park Preparatory Academy appear to have a design outdoor air exchange rate of 3 or above. When the outdoor air exchange rate is lower than the target 5 ACH, the document recommends the following strategies:

1. Increase outdoor air (see CCM #2)
2. Use MERV 13 filters (or greater) on recirculated air (see CCM #3)
3. Add portable air cleaners with HEPA filters to the classroom (see ECCM #1)

It should be made clear however, that a room that has less than what this document considers the bare minimum outdoor air exchange rate may meet or exceed the most current ventilation standards dependent on the space occupancy and therefore may not be considered under ventilated by code standards. The 5 ACH or greater recommendation is meant to address the pandemic conditions being experienced as this level of ACH would equate to nearly 100% outside air requirement for a conventional mixed air cooling & heating system.

The following tables describe areas and systems where the above measures as well as others presented in this report may be applied.

Columbus Park Elem. School IAQ Sampling Summary											
Space Tested	Temp. °F	Humidity % RH	CO2 %	TVOC ppm	HCHO ppm	Room Area SqFt	Room Ht. Ft	Volume Cubic Feet	Design OA CFM	OA Air ACH	Notes
Basement Floor											
S.P.E.D.	74.2	29	478	1.3	0.2	612	11.41	6983	N/A	N/A	
Kindergarten	74	28.5	479	0	0	1153	11.41	13156	N/A	N/A	
Cafeteria	73.2	30.6	482	1.63	0.28	2078	11.41	23710	N/A	N/A	
Teachers Café	74.9	28.4	484	1.52	0.22	529	11.41	6036	N/A	N/A	
Classroom 105	75.8	28.3	479	1.48	0.22	767	11.25	8629	N/A	N/A	
Custodian Office	77.2	27.1	489	1.48	0.22	342	11.833	4047	N/A	N/A	
Classroom 103	76.5	26.5	469	1.4	0.23	807	11.916	9616	N/A	N/A	
Classroom 101	77.2	26.6	461	1.35	0.21	767	10.33	7923	N/A	N/A	
1st Floor											
Gym	71.9	28.7	465	1.33	0.19	4830	23.25	112298	N/A	N/A	
S.A.C. Office	70.4	31	486	1.41	0.22	126	8	1008	N/A	N/A	
Nurse	70.4	31.5	499	1.34	0.19	144	9.75	1404	N/A	N/A	
Classroom 205	73.7	26.9	459	1.32	0.18	799	13	10387	630	3.6	
Principal	74.1	26.4	461	1.33	0.18	221	13.083	2891	N/A	N/A	
Main Office	72.5	27.9	481	1.31	0.19	231	13	3003	N/A	N/A	
Classroom 207	71.8	31.9	454	1.3	0.19	965	13	12545	N/A	N/A	
Kindergarten 203	72	28.4	461	1.32	0.18	787	13.083	10296	N/A	N/A	
S.P.E.D.	71.2	29.9	475	1.33	0.19	285	13	3705	N/A	N/A	
Kindergarten 201	70.4	29.2	464	1.31	0.18	854	13	11102	630	3.4	
2nd Floor											
Classroom 306	70	32.9	473	1.44	0.19	798	12.916	10307	630	3.7	
S.P.E.D.	68.4	30.2	452	1.35	0.18	296	12.916	3823	N/A	N/A	
Psych/S.P.E.D. Office	66.1	33.1	445	1.31	0.18	261	9.833	2566	N/A	N/A	
Classroom 303	66.3	75.1	482	1.33	0.18	787	9.833	7739	N/A	N/A	
Boys Bathroom	68.9	30.7	467	1.31	0.19	257	13	3341	N/A	N/A	
Classroom 301	68.6	30.5	467	1.2	0.18	806	13	10478	630	3.6	

Note: As noted previously, the TVOC readings tended to drift up during the study, possibly due to a calibration issue, as such, the readings in this report were only used to identify areas where possible ventilation issues may exist and/or to identify areas where a source contaminant may be causing elevated levels.

Ventilation System Summary & Recommendations:

The following table is based on original design drawings and reflect most of the systems which provide ventilation air to the building. The units ID tag, area served, ventilation data and filter efficiencies are listed. The table also reflects possible COVID Control Measures (CCM) and Enhanced COVID Control Measures (ECCM) described later in this report which may apply to such systems to improve performance either during pandemic conditions and/or post pandemic conditions.

We highly recommend at least minimum outdoor air be provided in areas which do not have such systems or if existing ventilation systems are not operational. For example, office areas should be supplied with OA ventilation as none appears to exist.

Columbus Park Prep. Academy Ventilation System Summary										
Unit ID	Area Served	Exist. Supply CFM	Exist. O.A. CFM	Exist. O.A. %	Exist. Filter Qty & Size	Exist. Filter MERV Rating	Exist. Filter Vel. (FPM)	Proposed CCM #	Proposed ECCM #	Notes
AHU-1	Gym	N/A	N/A	100	N/A	8	N/A	#1, #2	#1, #3	a
AHU-2	Unknown	N/A	N/A	N/A	N/A	8	N/A	#1, #2	#1, #3	a
Misc. UV's	Throughout	N/A	N/A	N/A	varies	8	N/A	#1, #2	#1, #3	a, b

Ventilation System Summary Notes:

- a. *For individual classrooms and other areas noted, ECCM #1 – Portable Air Filtration and/or ECCM #3 – Ionization, are noted as possible options to improve air cleaning and changeover during pandemic conditions.*
- b. *We highly recommend outdoor air of some level be provided, even if via windows as there is no substitute for proper ventilation regardless of other measures employed.*

II. COVID-19 HVAC MITIGATION MEASURES

A. HVAC COVID-19 CONTROL MEASURES

In line with the current American Society of Heating Refrigeration and Air Conditioning Engineers (ASHRAE) Epidemic Task Force Building Readiness Guidelines (updated 10-20-2020) and those from the Harvard T.H. Chan School of Public Health - 5-Step Guide to Checking Ventilation Rates in Classrooms, as well as other industry recommendations the following HVAC COVID Control Measures (CCM's) are presented for consideration to assist in mitigating virus transmission thru the HVAC systems.

The ASHRAE Epidemic Task Force recommends several measures to assist in COVID-19 mitigation with more aggressive action with epidemic conditions in place (ECiP) and post-epidemic conditions in place (P-ECiP). For ECiP conditions in place the HVAC COVID-19 Control Measures (CCM) that could be readily applied to the Columbus Park Preparatory Academy surveyed are outline herein. Refer to the Ventilation System Summary Table for applicable CCM recommendations.

It is imperative that all systems be maintained and checked to confirm proper operation in line with their original design, adjusted where applicable, as described herein. In addition, a Testing and Balancing company should be enlisted to adjust and confirm all systems are properly achieving their design outdoor air, supply air and exhaust air levels.

CCM #1 – Pre & Post Purge

Pre- and post-purge ventilation of occupiable spaces using outside air introduced the HVAC systems. This would be accomplished by starting the ventilation systems in occupied mode (i.e., OA at design or higher) 4 hours prior to schedule building occupancy and maintain the occupied mode for 4-hours after occupancy ends.

Most of the HVAC systems supporting the Columbus Park Preparatory Academy appear to be capable of implementing this measure.

CCM #2 – Increased Ventilation

Increase outdoor air ventilation for improved space dilution where systems allow. This would entail increasing the minimum outdoor air damper positions on all mixed air style systems within the limits of the equipment capacity and overriding any demand ventilation reset schemes (i.e., CO2 reset). A control sequence would need to be implemented for the respective air handlers which would limit the outdoor air volume to the unit's respective capability such that proper control of the discharge air can be maintained as well as freeze protection of coils. In addition, sequence would need to include limitation based on boiler plant and cooling system capabilities and summertime moisture limitations. For buildings which have anti-freeze in water-based heating and/or cooling systems concern of unitary coil freeze up is reduced.

Most of the classroom UV systems as well as the AHU systems appear to have the ability to increase outdoor air for higher outdoor air ventilation and air exchange rate.

CCM #3 – Improved Filtration

Improve filtration to up to MERV-13 on air handling systems, especially those which recirculate air. In addition, if possible, as filters are replaced provide sealant or gasketing between and/or around filters to reduced air bypass around filter sections.

Higher filtration on most of the AHU's may be considered subject to unit fan capabilities. Most, of the classroom unit ventilators cannot support filtration in excess of MERV 8. All replacement filters for these terminal units should meet MERV 8 requirements.

Prior to implementation of higher filtration levels in excess of MERV 8, existing equipment capabilities must be reviewed to verify it can support the added pressure drop imposed by MERV-13 filtration. Testing and Balancing to confirm current airflow, pressure drops, and fan motor power coupled with manuf. published data would be required to confirm the unit's capability for improved filtration.

B. ENHANCED HVAC COVID-19 CONTROL MEASURES

In addition to the suggested above measures below are some Enhanced HVAC COVID-19 Control Measures (ECCM) which could be considered for implementation. Refer to the Ventilation System Summary Table under the respective schools for applicable recommendations.

ECCM #1: Portable Room Purifiers

Portable room air purifiers could be used in select areas to help clean the air within that space. These could be applied in areas such as those where the population is in a higher risk group of developing COVID-19 complications or anywhere where real time space cleaning is required such as the nurse's office. Products which include HEPA filters and fans with air exchange rate appropriate for the size room should be selected.

ECCM #2: UV-C Light Sterilization

UV-C lights can be inserted in equipment and ductwork to help neutralize viruses as it is exposed to the light. UV technology has been studied and used extensively, primarily in hospital settings for virus and bacteria control and in the general HVAC primarily to prevent build-up on coils. To properly mitigate the virus an extended run of return air duct would need to be identified to allow for adequate exposure to UV-C light since a light bar just at the unit coil or filter will primarily just prevent build-up of mold, bacteria, and viruses on those surfaces.

ECCM #3: Bi-Polar Ionization

Air ionizers are meant to be installed in the supply air duct or plenum downstream of fans and filters. They are also offered as portable units for room application. In Columbus Park Preparatory Academy's case they could be installed in the supply air duct of the respective mixed air handling systems, in unit ventilators and portable units may be considered. WPS has already begun to incorporate Bipolar Ionization extensively throughout the Columbus Park Preparatory Academy to address the current pandemic condition.

Air ionizers appear to be showing quite a bit of promise for low system impact in retrofit applications. For years, these products have been used to primarily clean air of dust and particles by forcing the particles to bind together and either drop out of the breathing zone and/or better be able to be captured by HVAC system air filters by making particles larger. Recently, there are studies which claim to show that ionizers work on neutralizing virus's in the space prior to needing to draw these pollutants back to the units where filters and/or other cleaning technology such as UV-C could occur.

ASHRAE has not taken a definitive stance on Bipolar Ionization with regard to virus mitigation as of yet and has deferred to CDC's comment that it is still considered an emerging technology in this regard. Bipolar Ionization has been used for decades primarily for the removal of particles within the air. During that period, its use was focused more on facilities such as convention centers, airports, casinos, and the like as there are large amounts

of occupant and activity generated pollutants. Only recently has Bipolar Ionization been looked at for virus mitigation which is why ASHRAE and CDC still view it as an emerging technology being that there are not extensive 3rd party studies and reviews of its capability in this regard.

That said, even ignoring its potential virus neutralizing capabilities, the ability of the product to bind smaller particles into larger particles results in an overall desirable indoor air quality benefit in that it increases the capabilities of air filters to filter the air as well as promotes particles to drop out of the breathing zone. We do, however, recommend the technology be provided on systems that meet code required outdoor air ventilation levels as this technology is not a replacement for outdoor air.

Inevitably, during an epidemic, the best approach is a multi-faceted one and should include the above HVAC strategies as well as proper housekeeping (cleaning of spaces and surfaces), occupant actions (hand cleaning, wearing masks, social distancing, following recommended CDC guidelines) and other mitigation strategies.

2) Natural Ventilation Summary

Columbus Park School

Room Name / Number	Space Use	Net Floor Area (SF)	4% of Net Area	Number of windows by Type																Total open Area (SF)	Difference between actual and required SF	PASS?	Additional Notes			
				A 2.71 HOPPER	B 3.33 SNG HUNG	C 2.21 HOPPER	D 13.37 AWNING	E 1.83 SNG HUNG	F 1.47 SNG HUNG	G 1.02 SNG HUNG	H 7.22 SNG HUNG	J 6.19 SNG HUNG	K 7.50 SNG HUNG	L 5.63 SNG HUNG	M 0.96 SNG HUNG	N 1.15 SNG HUNG										
Basement																										
Supply Room	storage	366	14.64																				0.00	14.64	NO	
Room 101	classroom	766	30.64	4																			10.83	19.81	NO	
Room 102	classroom	769	30.76	4																			10.83	19.93	NO	
Toilets	toilet	347	13.88																				0.00	13.88	NO	
Room 103	classroom	806	32.24		4																		13.33	18.91	NO	
Room 103 - Closet	storage	24	0.96																				0.00	0.96	NO	
Art Supply	support	244	9.76																				0.00	9.76	NO	
Room 104	classroom	733	29.32		4																		13.33	15.99	NO	
Room 104 - Closet	storage	24	0.96																				0.00	0.96	NO	
Room 104 - XFRMR Room	support	78	3.12																				0.00	3.12	NO	
Room 105A - E.L.L.	classroom	311	12.44	1																			2.71	9.73	NO	
Room 105	classroom	767	30.68	4																			10.83	19.85	NO	
Teacher's Café	café	528	21.12																				0.00	21.12	NO	
Teacher's Café - Toilet	toilet	33	1.32																				0.00	1.32	NO	
Teacher's Café - Closet	storage	60	2.4																				0.00	2.40	NO	
O.T.P.T.	support	427	17.08																				0.00	17.08	NO	
Speech Room	support	117	4.68																				0.00	4.68	NO	
Cafeteria	café	2077	83.08			2																	4.42	78.66	NO	
Food Storage	storage	79	3.16																				0.00	3.16	NO	
Step Primary - Spec. Edu	classroom	661	26.44			2																	4.42	22.02	NO	
Pre-Kindergarten	classroom	612	24.48						1														13.37	11.11	NO	
Storage	storage	222	8.88																				0.00	8.88	NO	
Storage	storage	225	9																				0.00	9.00	NO	
Toilets	toilets	181	7.24																				0.00	7.24	NO	
Computer Lab	classroom	1152	46.08						1														13.37	32.71	NO	
Testing Room	classroom	193	7.72																				0.00	7.72	NO	
Storage	storage	217	8.68																				0.00	8.68	NO	
Room 107	classroom	816	32.64	4																			10.83	21.81	NO	
Custodian's Office	office	341	13.64					1															2.21	11.43	NO	
Storage (adj to stair)	storage	155	6.2																				0.00	6.20	NO	
First Floor																										
Boy's Room	toilet	216	8.64						2														3.67	4.97	NO	
Room 201 - Kindergarten	classroom	854	34.16																				37.13	-2.97	YES	
Room 201 - Toilet	toilet	73	2.92						1														1.83	1.09	NO	
Kindergarten Literacy Intervention	classroom	58	2.32																				0.00	2.32	NO	
Room 202 - Kindergarten	classroom	802	32.08																				30.94	1.14	NO	
Room 202 - Toilet	toilet	59	2.36																				6.19	-3.83	YES	
Kindergarten Literacy Intervention	classroom	61	2.44																				0.00	2.44	NO	
Spec Edu	classroom	285	11.4																				12.38	-0.98	YES	
Spec Edu - Toilet	toilet	32	1.28																				0.00	1.28	NO	
Storage	storage	18	0.72																				0.00	0.72	NO	
Room 203 - Kindergarten	classroom	796	31.84																				34.88	-3.04	YES	
Room 203 - Storage & Coats	storage	107	4.28																				0.00	4.28	NO	
Room 204A - Main Office	office	230	9.2																				0.00	9.20	NO	
Assistant Principal	office	165	6.6																				11.81	-5.21	YES	
Principal	office	220	8.8																				20.63	-11.83	YES	
Room 204D - Conference	conference	141	5.64																				0.00	5.64	NO	
Room 204D - Storage & Coats	storage	107	4.28																				0.00	4.28	NO	
Teacher's Planning	support	289	11.56																				3.67	7.89	NO	
Teacher's Planning - Toilet	toilet	33	1.32																				0.00	1.32	NO	
Room 205	classroom	799	31.96																				37.13	-5.17	YES	
Handicapped - Men's & Women's	toilet	119	4.76																				1.83	2.93	NO	
Nurse's Office	office	144	5.76																				1.83	3.93	NO	
Nurse's Office - Toilet	toilet	32	1.28																				0.00	1.28	NO	
S.A.C. Office	office	126	5.04																				0.00	5.04	NO	
Men's Room	toilet	119	4.76																				1.83	2.93	NO	
Closet	storage	42	1.68																				0.00	1.68	NO	
Storage	storage	37	1.48																				0.00	1.48	NO	
Gym Office	office	181	7.24																				1.83	5.41	NO	
Gymnasium	gym	4830	193.2																				28.88	164.33	NO	
Stage	gym	597	23.88																				0.00	23.88	NO	
Stage Office	office	121	4.84																				1.83	3.01	NO	
Stage Office	office	166	6.64																				1.47	5.17	NO	
Stage Office - Toilet	toilet	29	1.16																				1.02	0.14	NO	
Stage Office - Closet	storage	41	1.64																				0.00	1.64	NO	
Gym Equipment Storage	storage	325	13																				0.00	13.00	NO	
Room 206	classroom	799	31.96																				37.13	-5.17	YES	
Girl's Room	toilet	168	6.72																				3.67	3.05	NO	
Room 207	classroom	965	38.6																				33.75	4.85	NO	
Room 208	classroom	953	38.12																				33.75	4.37	NO	

Second Floor																													
Boy's Room	toilet	257	10.28																			3.67	6.61	NO					
Room 301	classroom	806	32.24																				37.13	-4.89	YES				
Room 302	classroom	806	32.24																				37.13	-4.89	YES				
Spec Edu	classroom	303	12.12																				12.38	-0.25	YES				
Spec Edu - Toilet	toilet	29	1.16																					0.00	1.16	NO			
Custodian	support	21	0.84																					0.00	0.84	NO			
Room 303	classroom	786	31.44																					33.75	-2.31	YES			
Room 303 - Storage & Coats	storage	107	4.28																					0.00	4.28	NO			
Psych / Spec Edu. Office	office	261	10.44																					2	2.30	8.14	NO		
Room 304	storage	786	31.44																					33.75	-2.31	YES	One K-type window has A/C unit		
Room 304 - Storage & Coats	storage	104	4.16																						0.00	4.16	NO		
Data Room	support	312	12.48																						3.67	8.81	NO		
Room 305	classroom	798	31.92																						36.00	-4.08	YES	One J-type window has A/C unit	
Balcony	aud	1275	51																						0.00	51.00	NO		
Storage	storage	191	7.64																						0.00	7.64	NO		
Storage	storage	171	6.84																						0.00	6.84	NO		
Supply Room	storage	208	8.32																						0.00	8.32	NO		
Room 306	classroom	797	31.88																							37.13	-5.25	YES	
Girl's Room	toilet	271	10.84																							3.67	7.17	NO	
Custodian	support	26	1.04																							0.00	1.04	NO	
Spec Edu	classroom	295	11.8																							22.50	-10.70	YES	
Spec Edu - Toilet	toilet	41	1.64																							0.96	0.68	NO	
Spec Edu	classroom	293	11.72																							30.00	-18.28	YES	
Spec Edu - Toilet	toilet	67	2.68																							8.46	-5.78	YES	
Kitchenette	kitchen	92	3.68																							0.00	3.68	NO	

Window Type	Width	Hieght	Projection	Venting
A - Hopper	35	17	7.5	2.71
B - Single Hung	40	12	-	3.33
C - Hopper	32	17	6.5	2.21
D - Awning	55.5	32	22	13.37
E - Single Hung	33	8	-	1.83
F - Single Hung	32.5	6.5	-	1.47
G - Single Hung	32.5	4.5	-	1.02
H - Single Hung	38.5	27	-	7.22
J - Single Hung	33	27	-	6.19
K - Single Hung	40	27	-	7.50
L - Single Hung	30	27	-	5.63
M - Single Hung	18.5	7.5	-	0.96
N - Single Hung	19.5	8.5	-	1.15
** Single Hung Windows could have stops removd o opened 27" **				

Room Color Key	
	Rooms that meet or exceed the minimum code required ventilation
	Rooms that do not meet the code required ventilation, but have operable windows.
	Rooms that do not have operable windows (either fixed or none present)